




Customer: _____
Job I.D.: _____
Attn.: _____

Hays MesurMeter Manual Balance Hose Kit

MesurMeter Cv's (refer to Catalog "How To Order Page" for Cv/Flow Range relationships)

Size / Cv's Available: $\frac{1}{2}$ " : 0.23, 0.46, 0.87, 1.80, 3.30, 5.40 $\frac{3}{4}$ " : 0.55, 1.10, 2.20, 4.00, 6.70 **1"** : 2.30, 5.40, 9.20, 20.0 **1- $\frac{1}{4}$ "** : 5.50, 9.80, 20.0, 24.0 **1- $\frac{1}{2}$ "** : 14.0, 19.0, 44.0 **2"** : 13.0, 24.0, 56.0

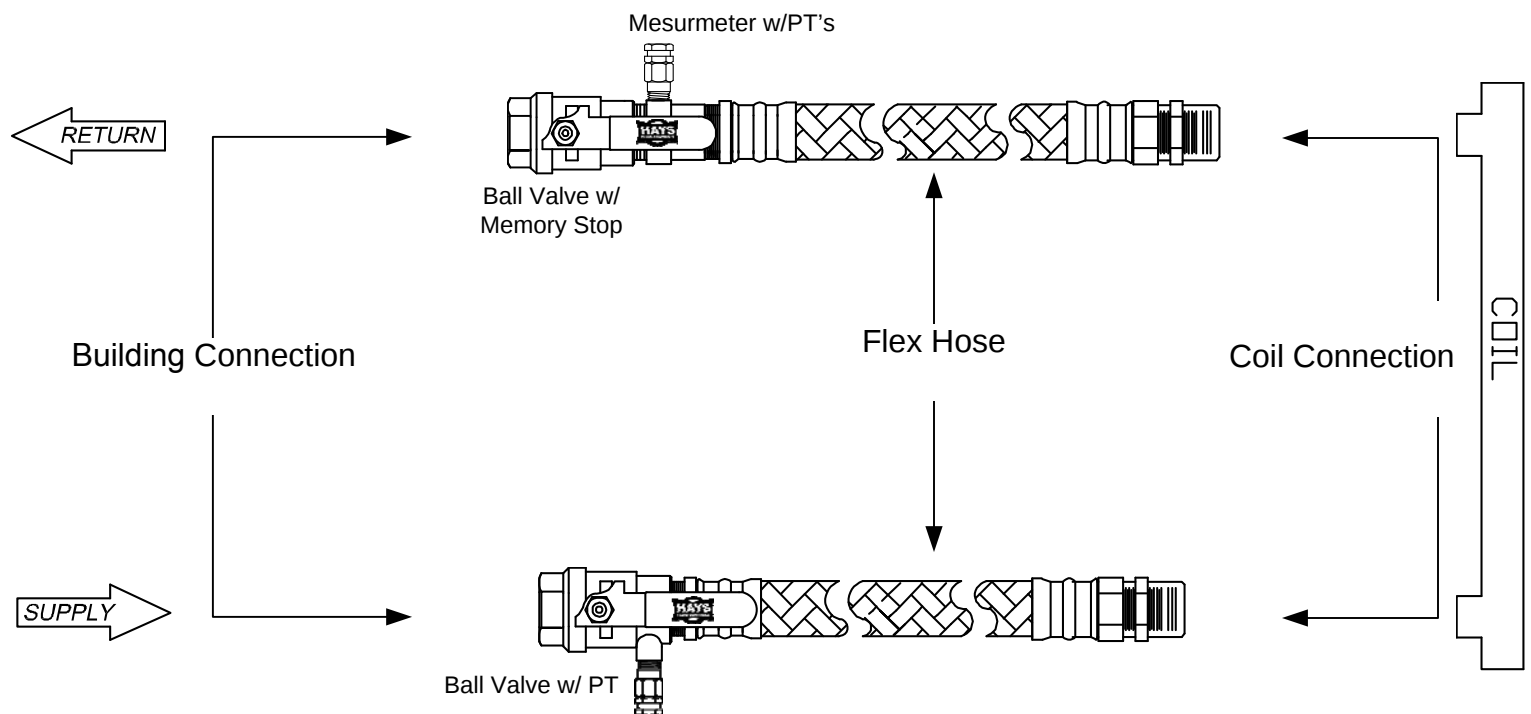

DWG. NUMBER _____

DWG. APPROVAL _____

DWG. SUBMITTAL DATE _____

DWG. SUBMITTED BY _____

QUOTE # _____

ALL HAYS PIPING PACKAGES ARE ASSEMBLED AND LEAK TESTED

DRAWING NOT TO SCALE

IMPORTANT: HAYS FLUID CONTROLS CANNOT GUARANTEE THAT ALL PIPING PACKAGES FIT WITHIN THE CONFINES OF A SPECIFIC INSTALLATION AREA.

FOR NONLIKE SIZE COMPONENTS, TRANSITION FITTINGS MAY BE REQUIRED THAT ARE NOT SHOWN ON THE DRAWING.